NESC 238
UNGROUNDED MAST ARMS
(Assume all streetlights are ungrounded unless ground is visible)

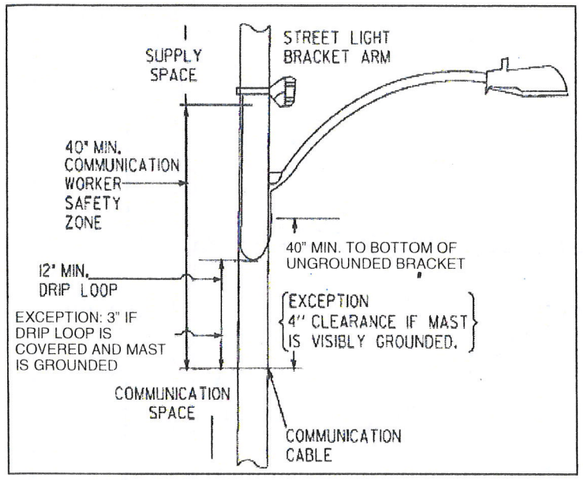

NESC 234C3d(2)
SUPPLY CLEARANCE TO WINDOWS

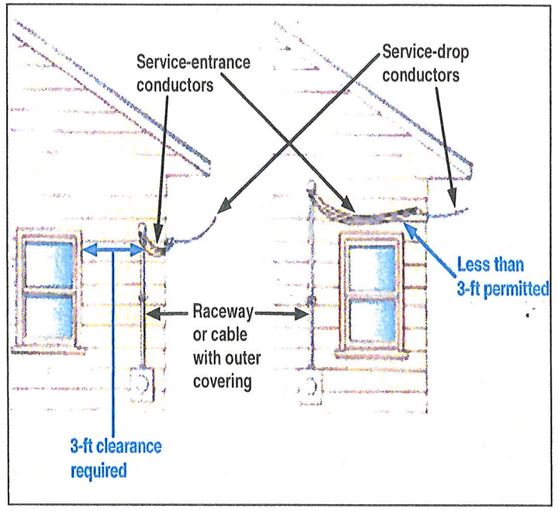

Notes

This is not an official codebook. This document is intended to provide reference for aerial clearances of Communications and Power facilities. When constructing aerial facilities, please refer to the governing codes, such as the National Electrical Safety Code, National Electric Code, Oregon Public Utility Commission Safety Rules, Oregon Occupational Safety and Health Administration, State, County and Municipal codes, and all other applicable company standards, including contracts.

Other Resources:

OJUA	www.ojua.org
OPUC	www.oregon.gov/PUC/safety/index.shtml
IEEE	www.ieee.org/portal/site
NESC	http://standards.ieee.org/nesc
OSHA	www.orosha.org/admin/safejobsb/sjsbagriculture.html

NESC 236
CLIMBING SPACE
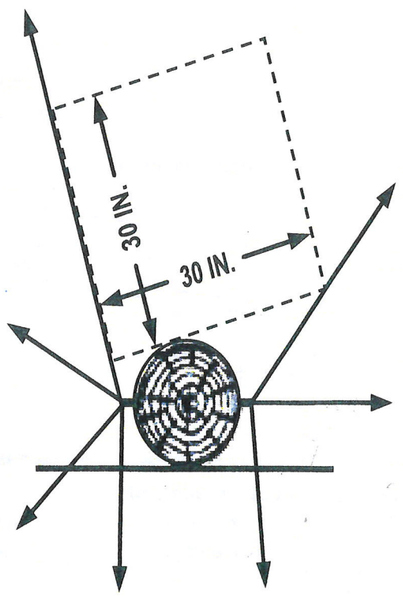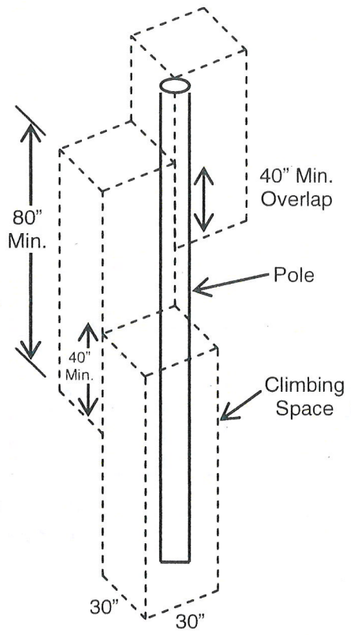
Climbing Space is an unobstructed, vertical space along the side or corner of the pole. In general, it consists of an imaginary box, 30 inches square, extending at least 40 inches above the highest communications cable or other facility and 40 inches below the lowest communications cable or other facility, but may be shifted from any side or corner to any other side or corner. Support arms are not considered to obstruct the climbing space.