


**NESC 234 CLEARANCES TO OTHER STRUCTURES**

Cables 300 V or less need to be a minimum two feet over the street light.

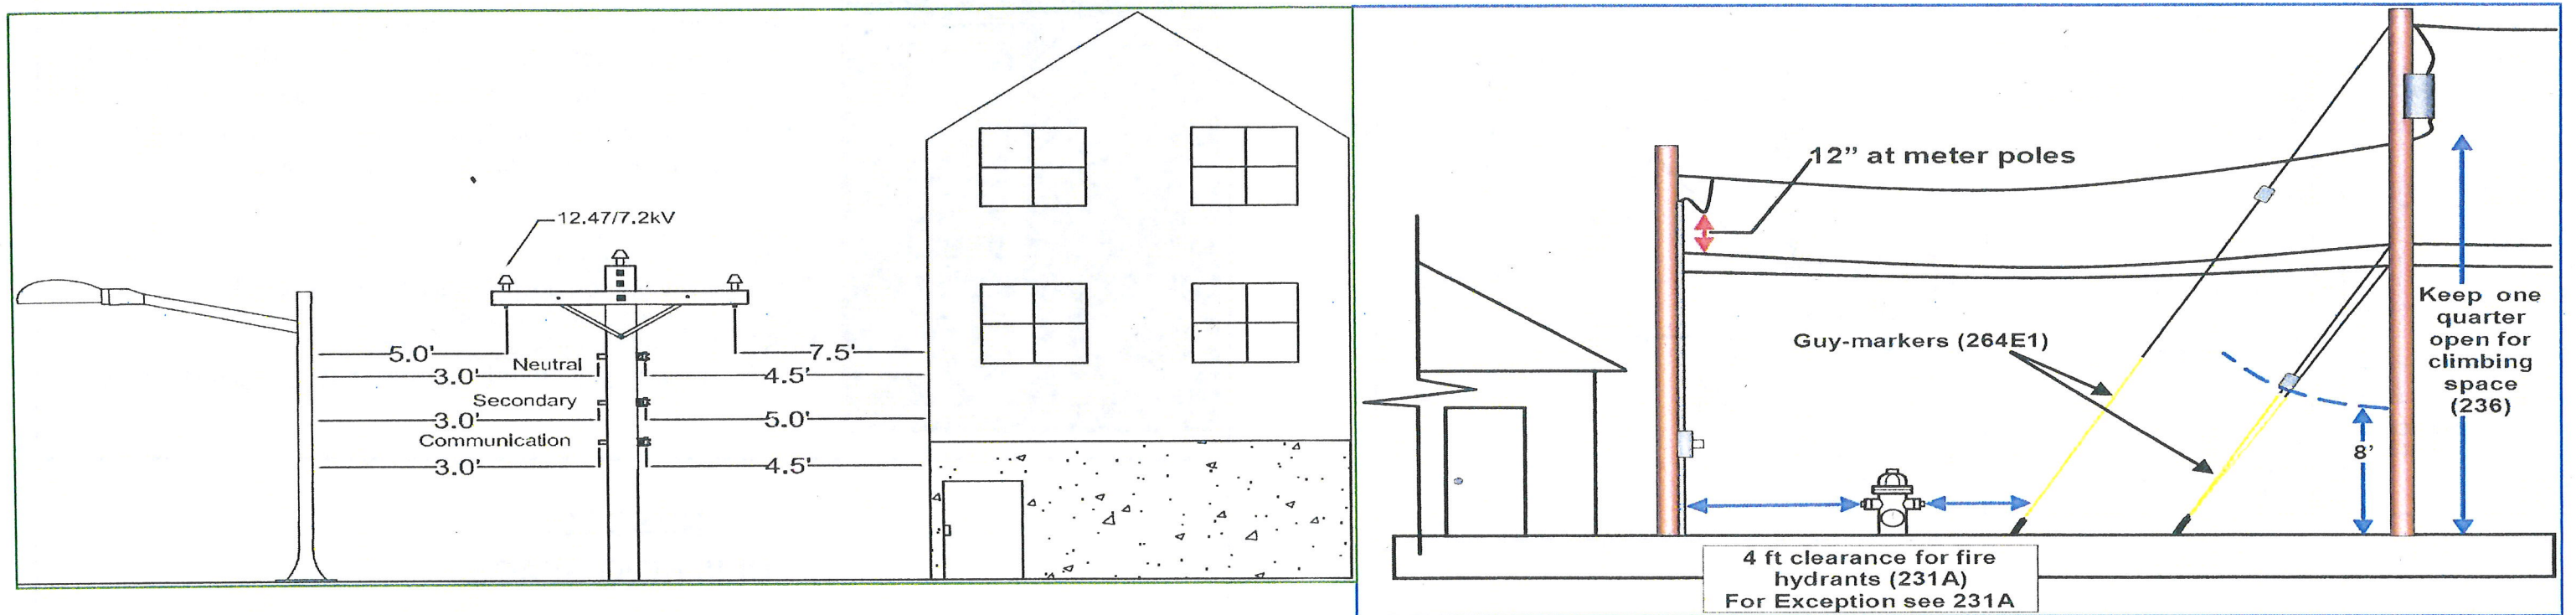

**MINIMUM ACCEPTABLE CLEARANCES**


NESC TABLE 232-1 VERTICAL CLEARANCE OVER SURFACES

NESC TABLE 235-5 VERTICAL CLEARANCE AT SUPPORTS

NESC 235C2b(1)(a) SAG RELATED CLEARANCES

NESC 235H CLEARANCE AND SPACING BETWEEN COMMUNICATIONS

*NOTE: These values are intended for NESC inspection reference only and are not intended for construction or design criteria.*

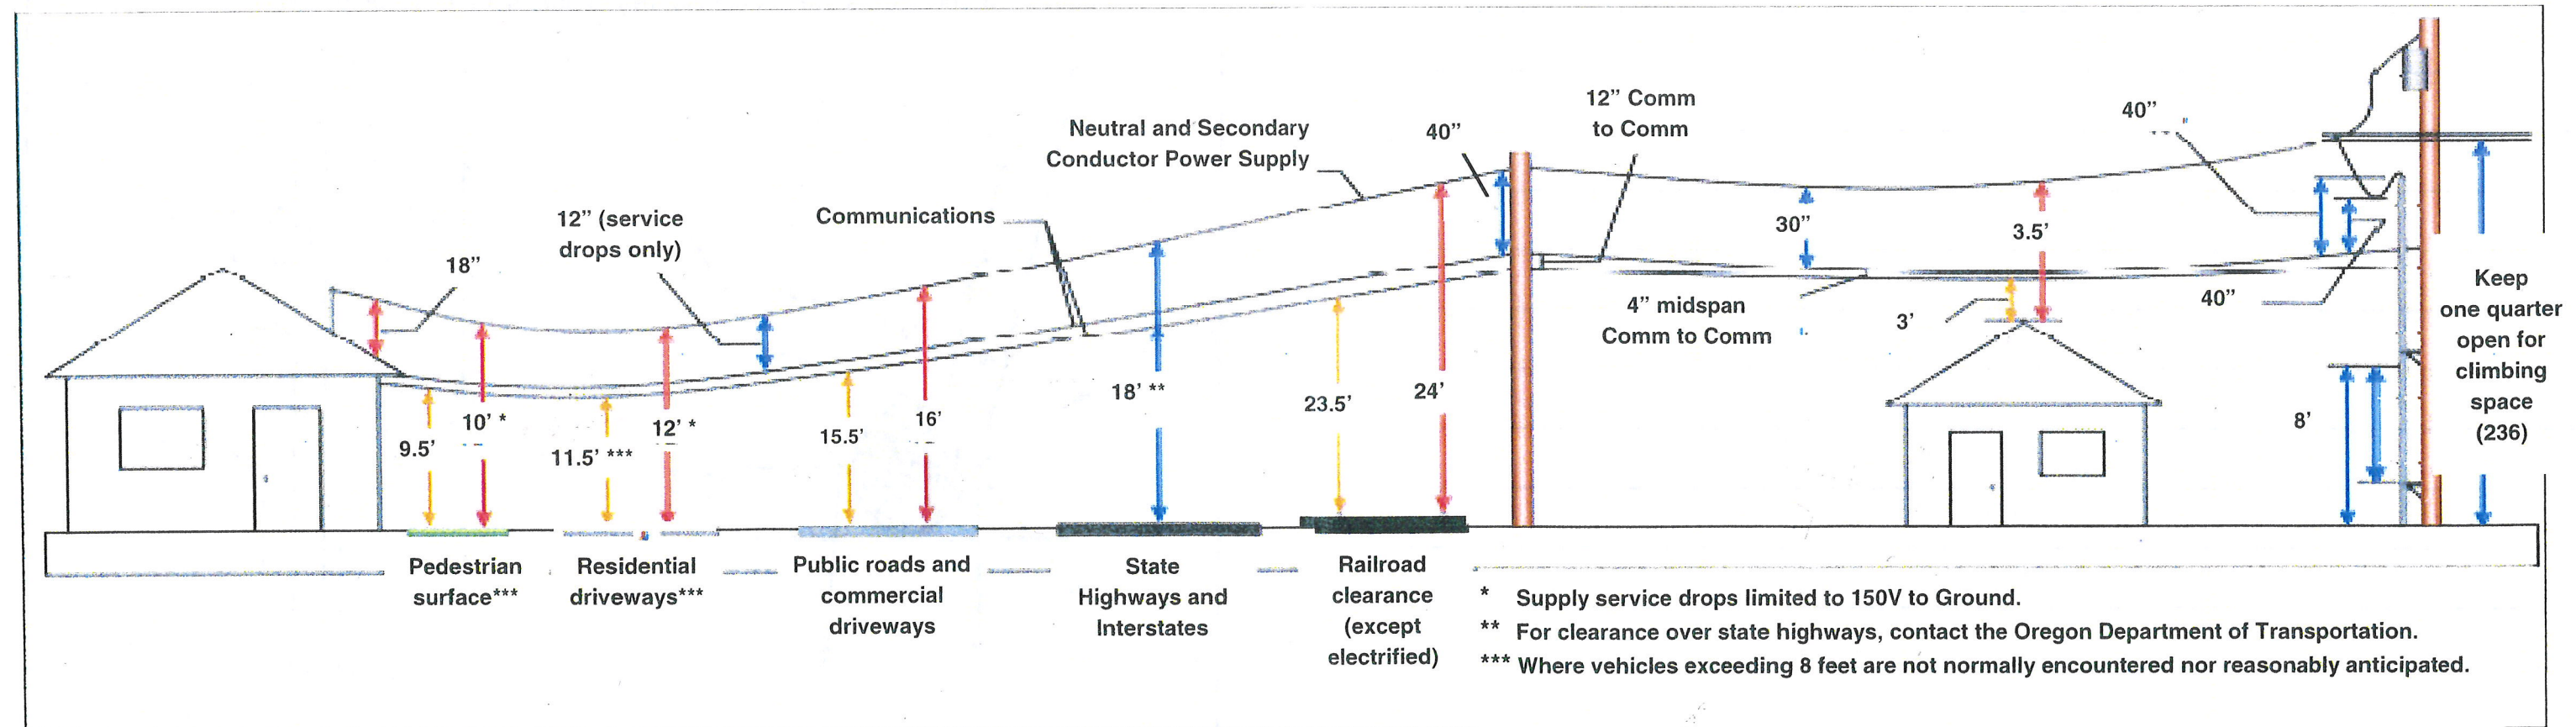

\* Supply service drops limited to 150V to Ground.  
 \*\* For clearance over state highways, contact the Oregon Department of Transportation.  
 \*\*\* Where vehicles exceeding 8 feet are not normally encountered nor reasonably anticipated.